


**Enlargement**  
CleanStream must not be installed below this level.



**Installation Instructions**  
Refer to "Installation Manual CleanStream TXR Biofiltration Textile System"

**Water filling of chambers**  
Primary 1 - 3000L  
Primary 1 - 3000L  
Recirculation - 1500L  
Irrigation - 500L

**Electrical Instructions**  
Refer to "Electrical Wiring Instructions for CleanStream TXR Sewage System Controller" located under the control box.

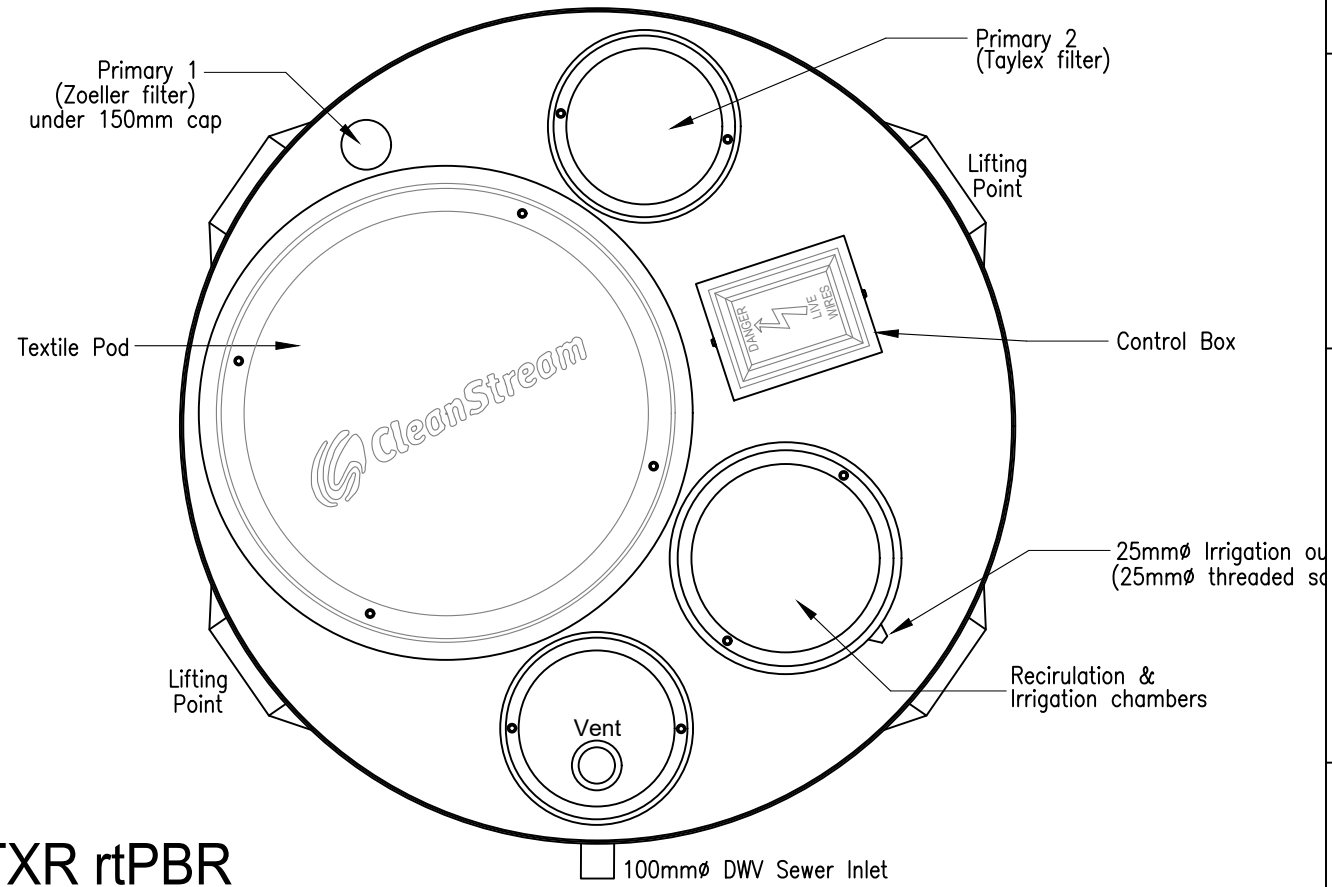

### CleanStream TXR rtPBR

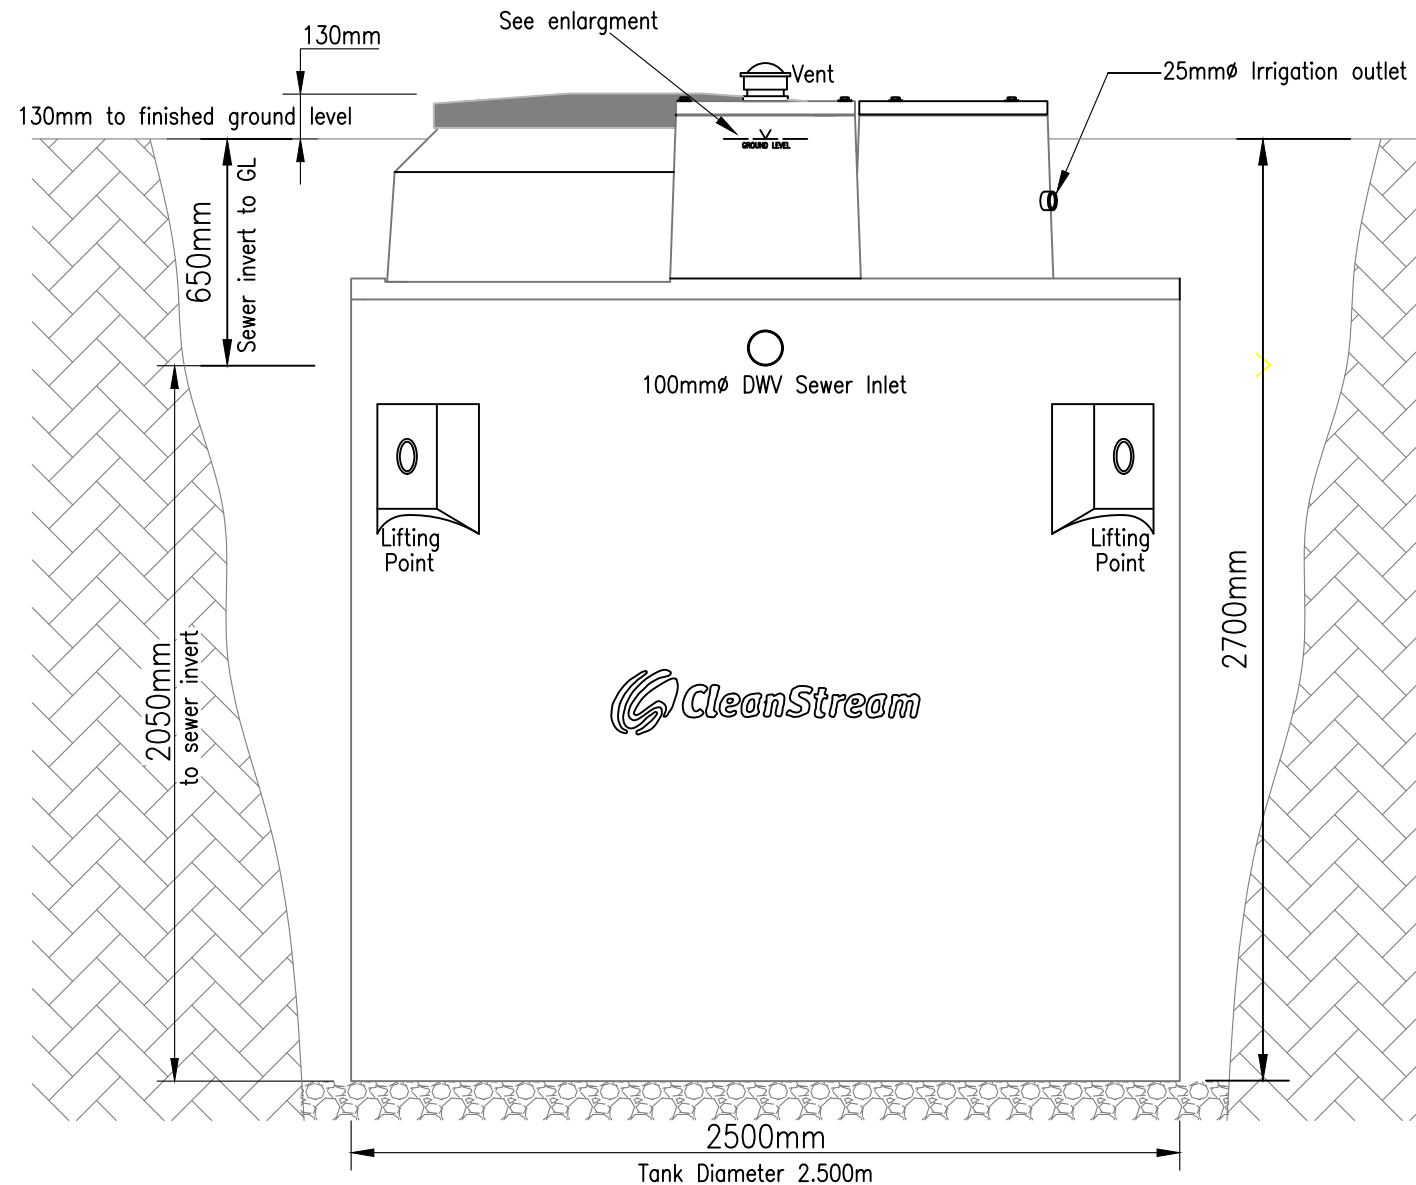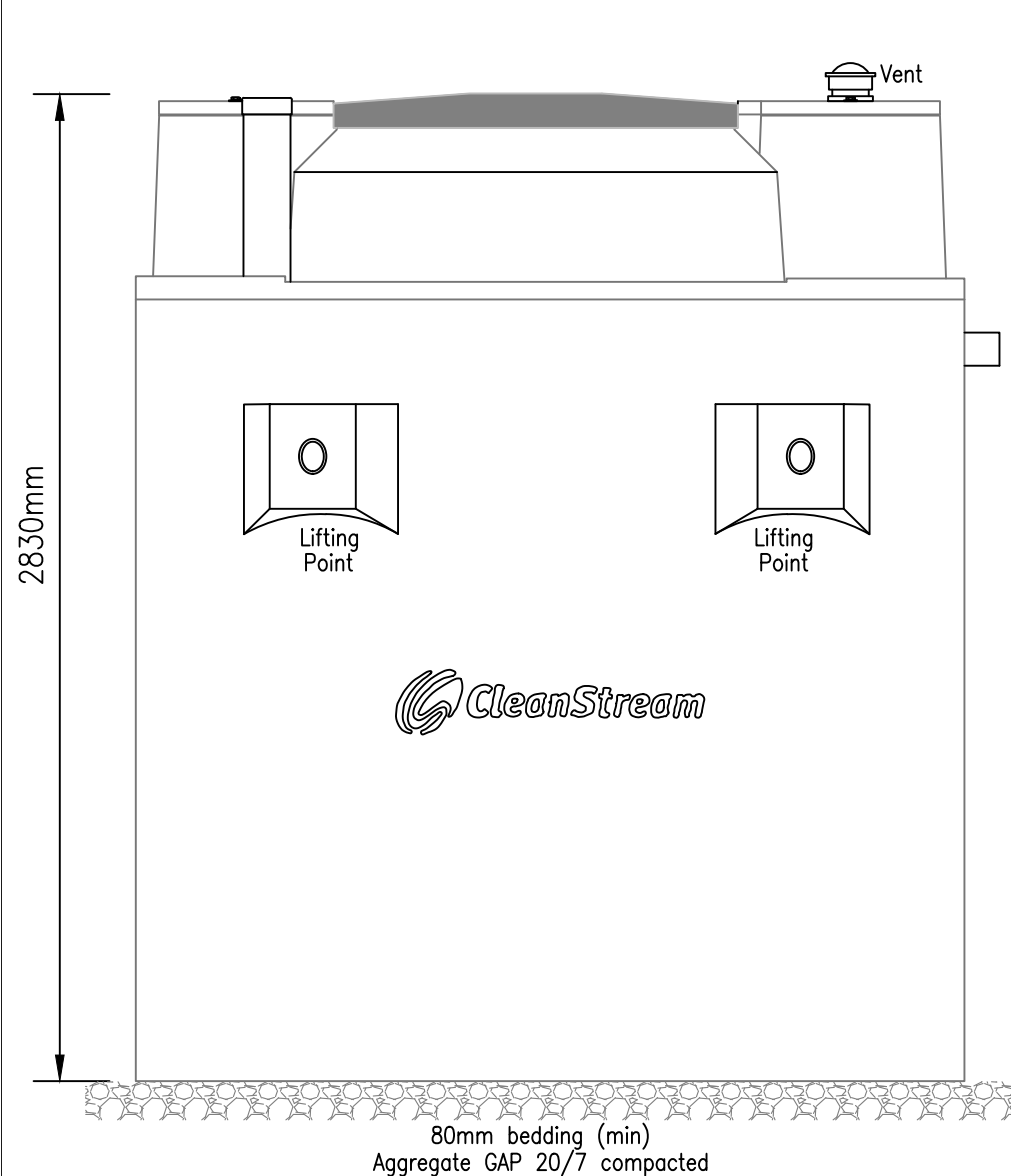

DO NOT SCALE  
CONTRACTOR MUST VERIFY  
ALL DIMENSIONS ON SITE  
BEFORE COMMENCING WORK



T: 0800 387 227  
M: 021 951 054  
E: gerald@duracrete.co.nz  
W: www.duracrete.co.nz

PROJECT:  
**CleanStream TXR-1**

SHEET:  
**CleanStream Installation Diagram**

NOTES:

NO.	DATE	REVISION	BY:

PAGE SIZE: A3  
SCALE: As Shown  
REF: 201006-506  
DATE: 15-11-2022  
DRAWN: GL

DRAWING #:  
**1 of 1**

© COPYRIGHT  
THIS DESIGN AND DRAWING IS  
COPYRIGHT OF DURACRETE  
PRODUCTS LTD. IT MAY NOT BE  
COPIED OR REPRODUCED IN  
ANY FORMAT OR IN ANY MEDIUM  
WITHOUT THE WRITTEN  
AUTHORISATION FROM  
DURACRETE PRODUCTS LTD.